

MEDIUM VOLTAGE FUSE

CAT. NO. A055F1DOR0-(10E-200E)  
A055F2DOR0-(250E-450E)


10E-450E 5.5KV

PEAK LET THRU CURRENT DATA



Newburyport, MA 01950

720607

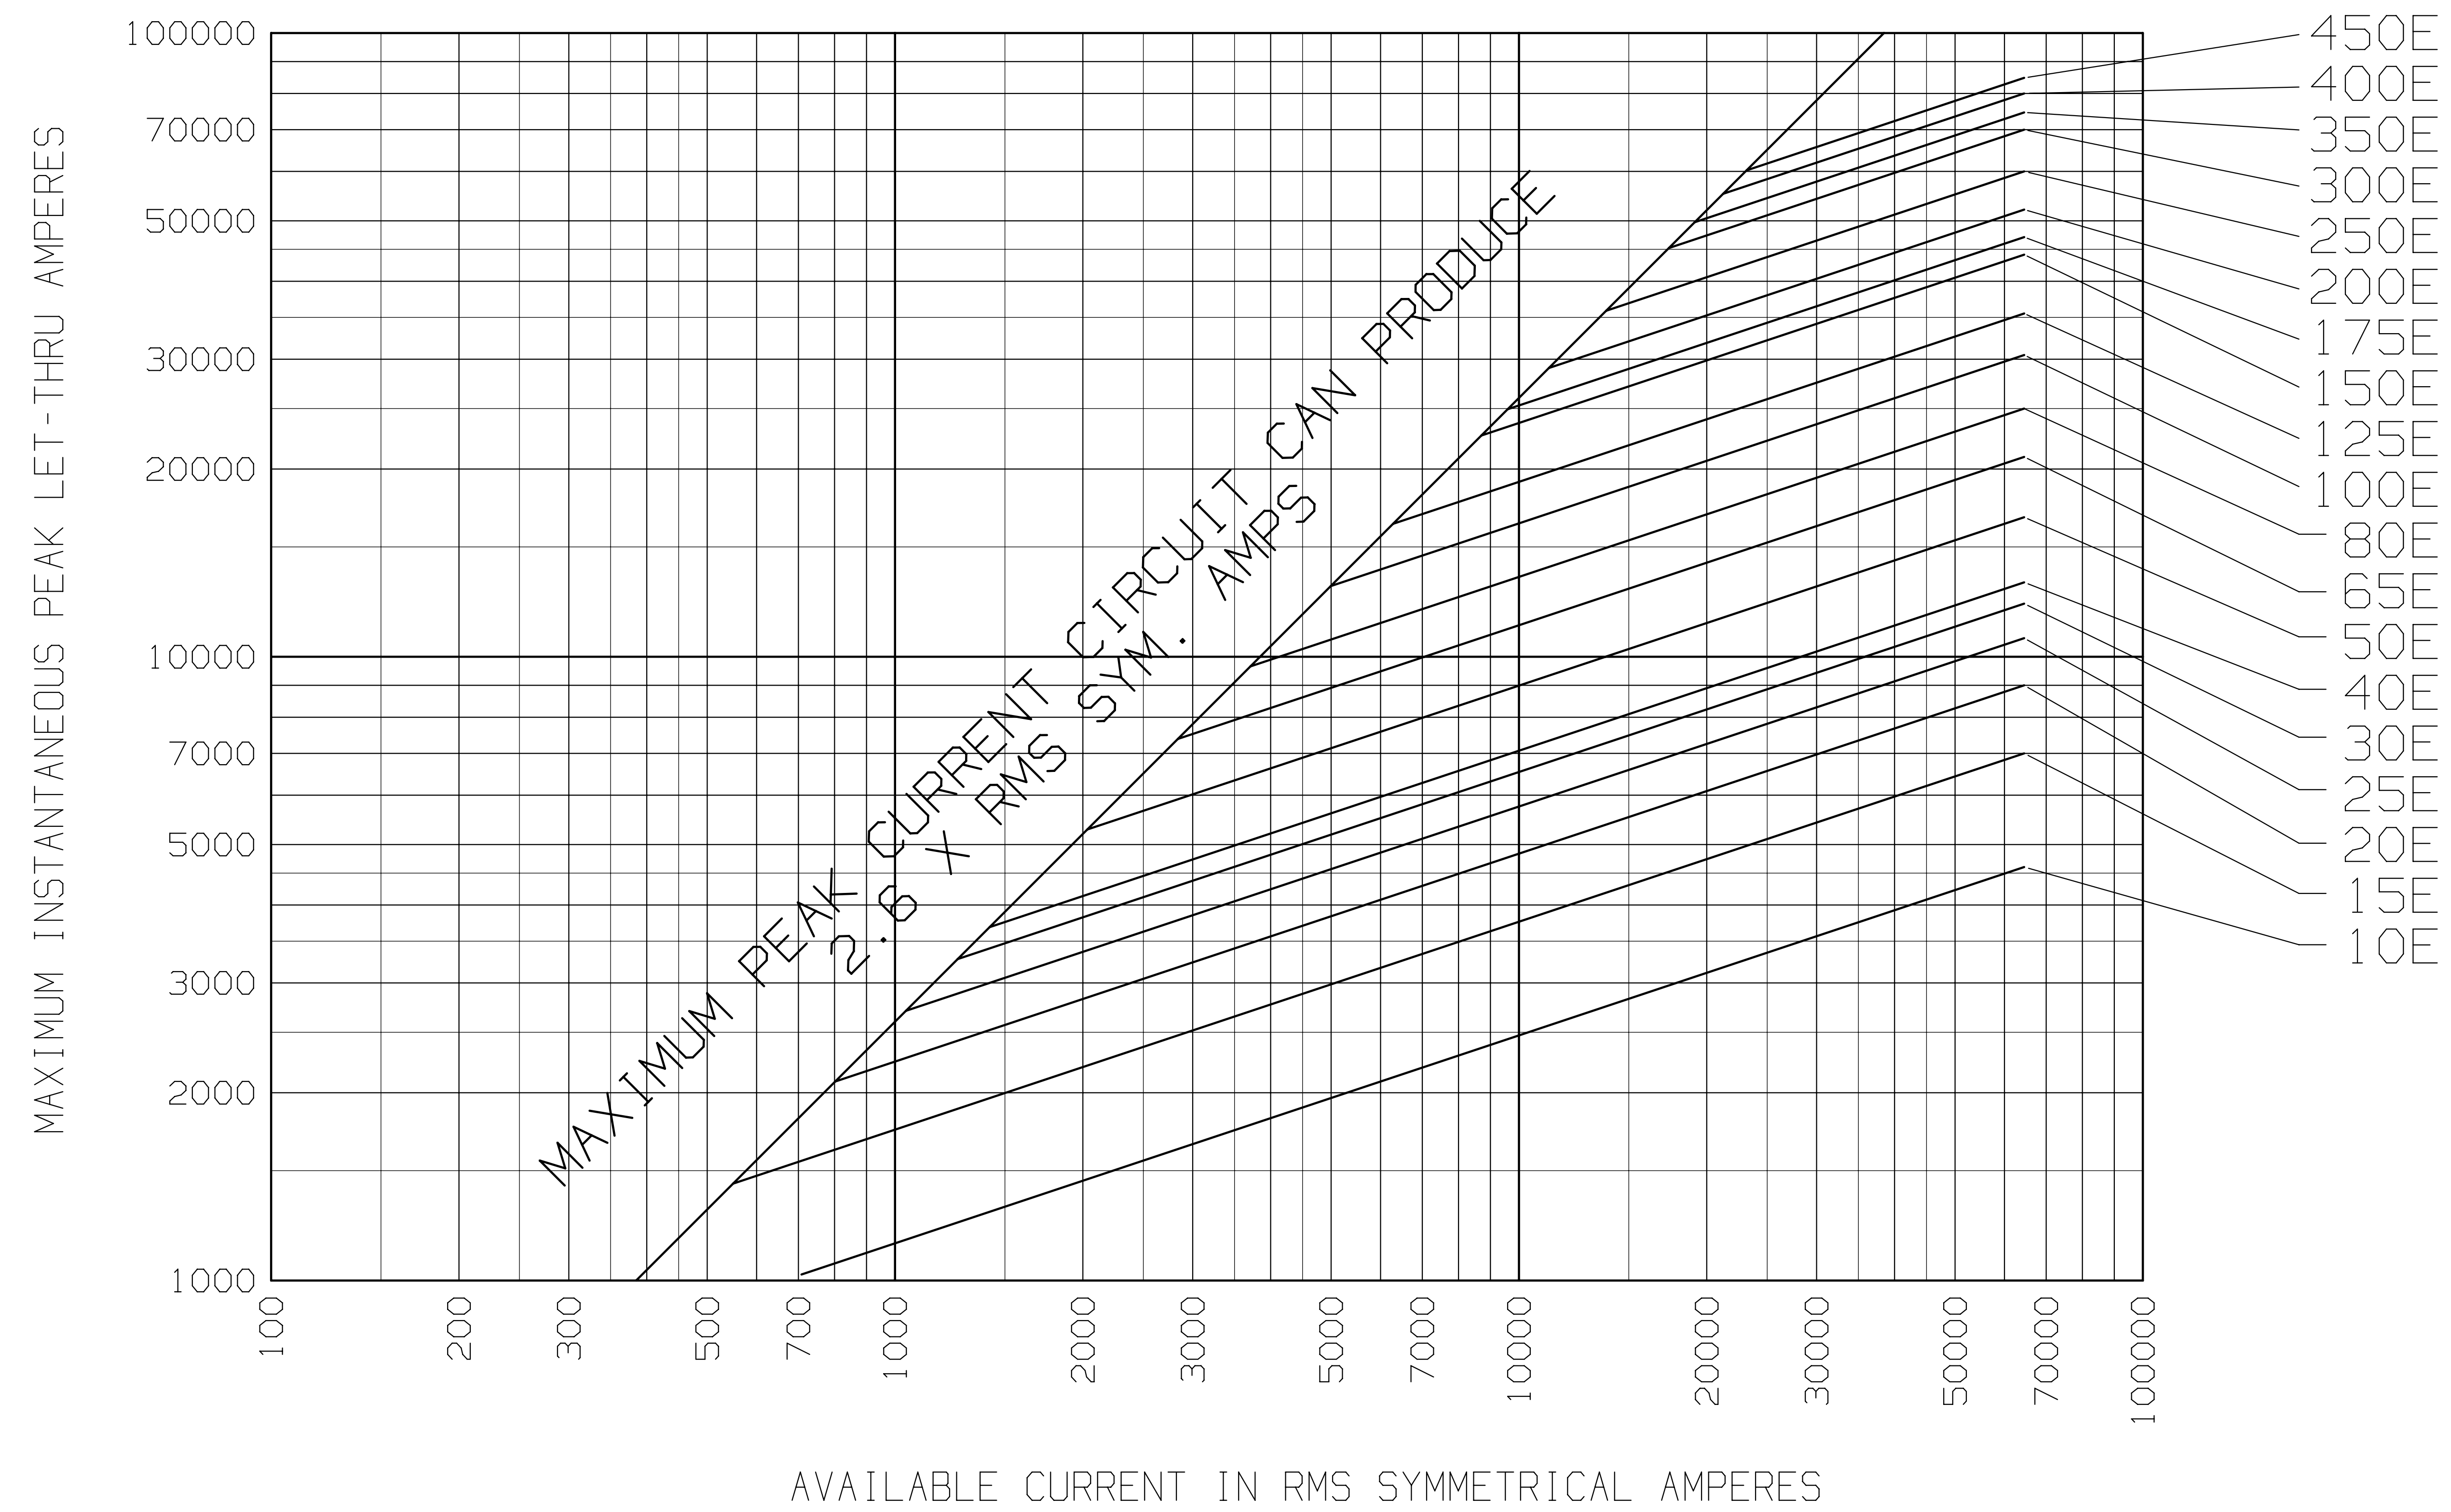

CONTROL NO.: 639  
REV.: -  
FOLDER NO.: 5B  
8/11/04